

# R91G, R91W

## Special purpose regulator

### Water or compressed air

### G1/4, 1/4 PTF

**Bonnet and body made from acetal plastic.**

**R91W: Use with deionize water and potable water systems. All elastomers are CFR 21 FDA food and water contact compliant. Non relieving models only.**

**R91G: Designed for use with non-potable water and compressed air systems. Non relieving and relieving models.**

**Low torque, non-rising adjusting knob.**

**Snap action knob locks pressure setting when pushed down.**

**Can be disassembled without the use of tools or removal from the air or water line.**



### Technical features

#### Medium:

R91G: Compressed air and non-potable water

R91W: Potable water, deionized water

#### Max. pressure:

10 bar

#### Typical flow :

See table below

#### Gauge ports:

1/8 PTF with PTF main ports

R1/8 with ISO G main ports

#### Ambient/Media temperature:

Water service: +2° ... +52°C

Air service: -20° ... +52°C

When used in air service, air supply must be dry enough to avoid ice formation at temperatures below +2°C.

#### Materials

Body and bonnet: Acetal

Valve seat: Acetal

Gauge port plugs: PP

R91G:

Valve: brass/NBR

Valve seat o-ring: NBR

Diaphragm: Acetal/PA inserted NBR

R91W\*:

Valve: Stainless steel/food grade

EPDM


Valve seat o-ring: food grade EPDM

Diaphragm: Acetal/PA inserted

NBR, food grade

\* NSF/ANSI 61 approved materials

### Technical data, standard models

Symbol	Port size	Application	Outlet pressure (bar)	Flow *1) (dm³/s)	Flow *2) (l/min)	Relieving	Gauge	Weight (kg)	Model
	G 1/4	Industrial air and non-potable water	0,3 ... 8,6	11	6,6	Without	Without	0,07	R91G-2GK-NLN
	G 1/4	Potable water and deionized water	0,3 ... 8,6	11	6,6	Without	Without	0,07	R91W-2GK-NLN

\*1) Approximate compressed air flow with 10 bar inlet pressure, 6,3 bar set pressure and a 1 bar droop from set.

\*2) Approximate water flow with 7 bar inlet pressure, 4 bar set pressure and a 1 bar droop from set.

### Option selector

**R91★-2★K-★★★**

Application	Substitute
Industrial air, non-potable water	G
Potable water, deionized water	W
Threads	Substitute
PTF	A
ISO Rc taper	B
ISO G parallel	G
Diaphragm	Substitute
Non relieving	N
Relieving (only R91G)	R


Gauge	Substitute
With	G*3)
Without	N
Outlet pressure *4)	Substitute
0.3 ... 3.5 bar	E
0.3 ... 8.6 bar	L

\*3) Gauge with NSF approved materials not available.

\*4) Outlet pressure can be adjusted to pressures in excess of, and less than, those specified. Do not use these units to control pressures outside of the specified ranges.


## Air flow characteristics

Port size: 1/4", Spring range: 0,3 ... 8,6 bar,  
Inlet pressure: 10 bar

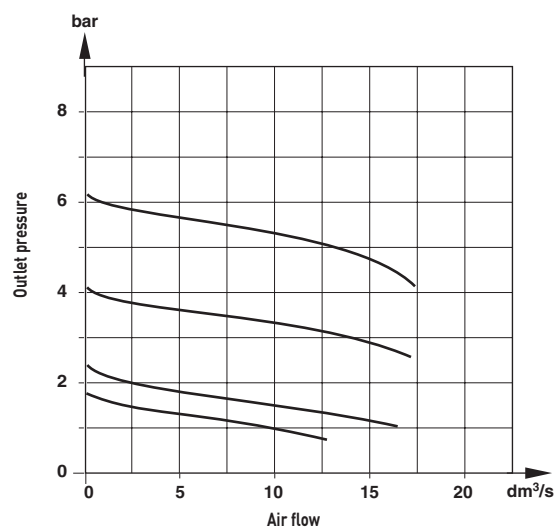

## Water flow characteristics

Port size: 1/4", Spring range: 0,3 ... 3,5 bar,  
Inlet pressure: 7 bar

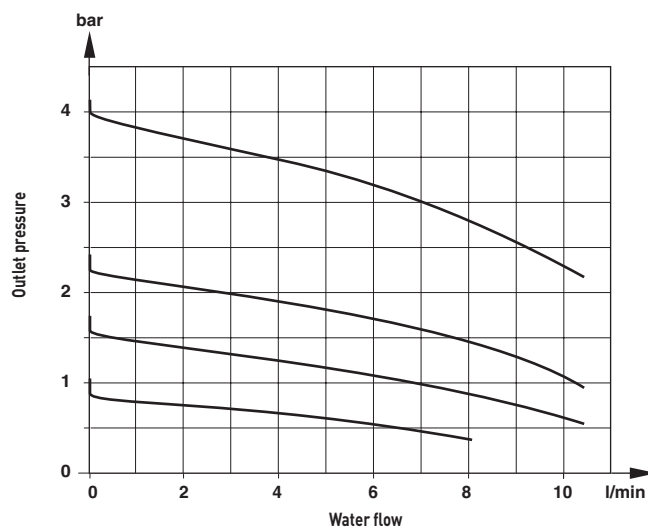





## Accessories



## Service kits




Wall mounting bracket and panel nut	Panel nut	Tamper resistant field modification	Gauge ø 40 mm *1)
			
<b>1 &amp; 4</b>	<b>4</b>	<b>3</b>	<b>6</b>
18-025-003 (with plastic nut)	2962-04 (Metal)	18-001-092	18-013-990 (0 ... 4 bar)
18-025-004 (with metal nut)	2962-89 (Plastic)		18-013-989 (0 ... 10 bar)

\*1) Gauge with NSF approved materials not available.

## Dimensions

## Mounting bracket

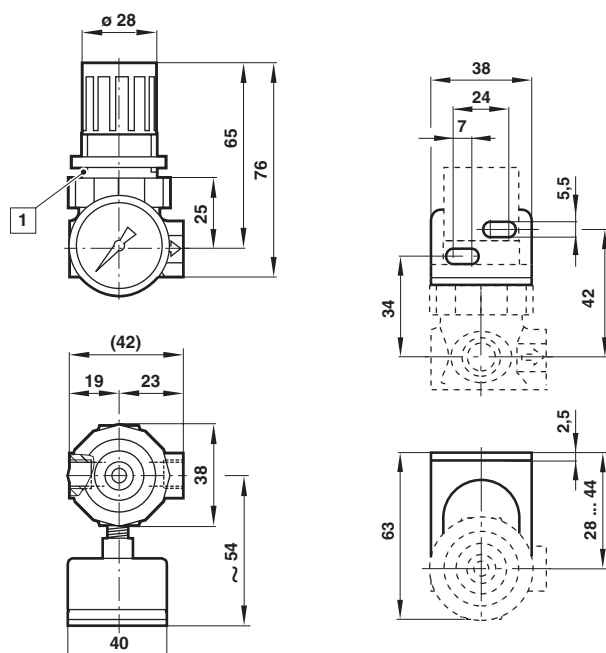

1 Panel mounting hole  $\varnothing$  30 mm

## Warning

These products are intended for use in industrial compressed air and water systems only. Do not use these products where pressures and temperatures can exceed those listed under **»Technical features«**.

Before using these products with fluids other than those specified, for non-industrial applications, life-support systems, or other applications not within published specifications, consult NORGREN.

Through misuse, age, or malfunction, components used in fluid power systems can fail in various modes.

The system designer is warned to consider the failure modes of all component parts used in pneumatic or water systems and to provide adequate safeguards to prevent personal injury or damage to equipment in the event of such failure.

System designers must provide a warning to end users in the system instructional manual if protection against a failure mode cannot be adequately provided.

System designers and end users are cautioned to review specific warnings found in instruction sheets packed and shipped with these products.